

Pole Barn/Utility Building Cross Section

Name

Snow Load (30 lbs. Min. Required)

Girt Size

Purlin Size

Pole Spacing

Header Size

Truss Spacing

Treated Grade Board Size

Pole Size (Treated)

Roof Materials

Siding Materials

Floor Depth and Type

Window Dimensions


Door Type(s) and Dimensions

Total Square Feet

Pole Grade (Min. Ret. AWPA LP22 0.60# pfc/UC4B

Engineered Truss Drawing Required

Lateral Bracing to Truss Manufacturer Specs.

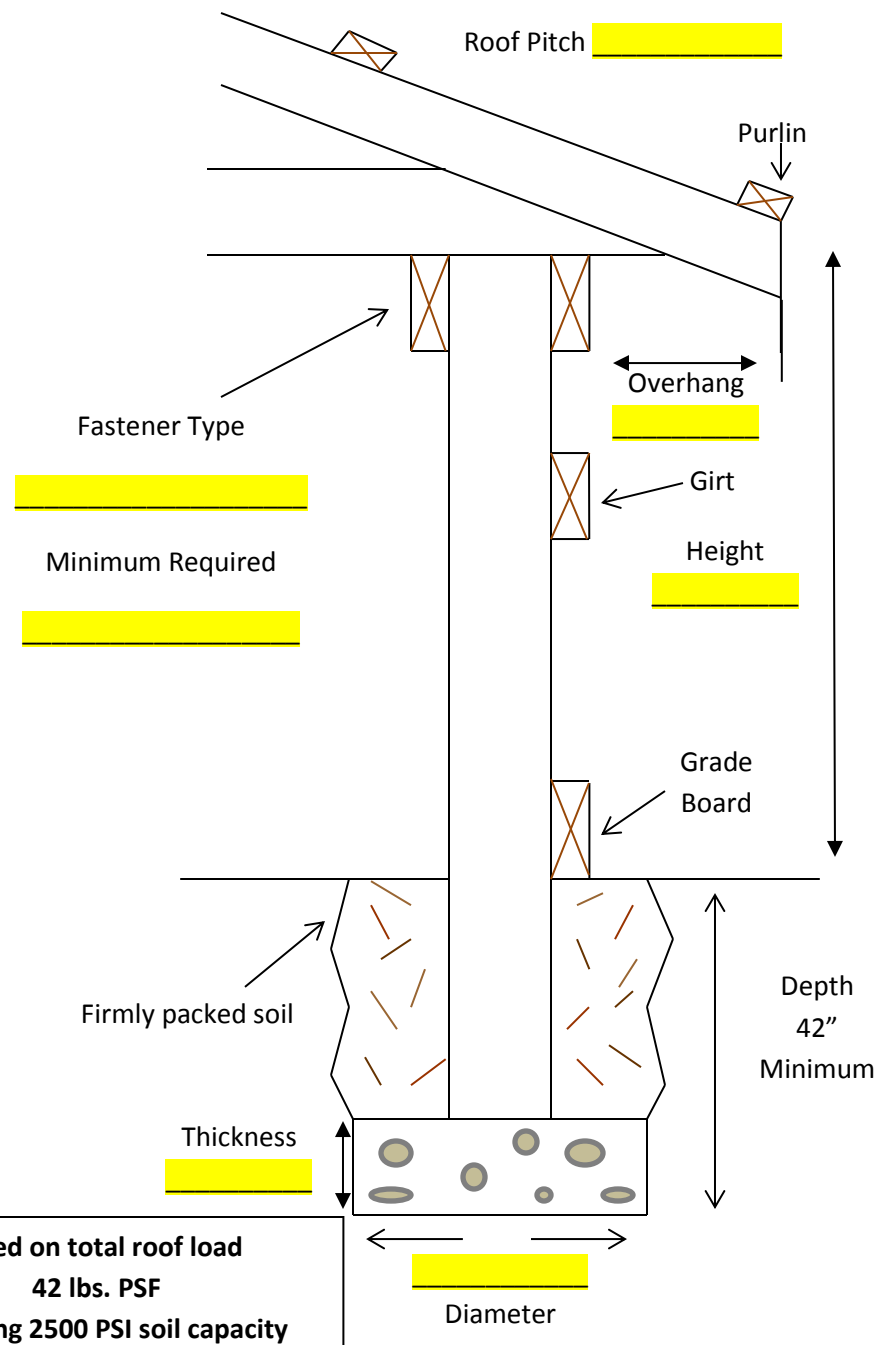

Building Width		20'	24'	26'	28'	30'	32'	34'	36'	40'
8' Post	Hole Diameter	16"	18"	20"	20"	20"	22"	22"	22"	24"
Spacing	Concrete Thickness	8"	8"	8"	8"	8"	8"	8"	8"	10"
10' Post	Hole Diameter	18"	20"	22"	22"	24"	24"	24"	24"	26"
Spacing	Concrete Thickness	8"	8"	8"	8"	10"	10"	10"	10"	10"